
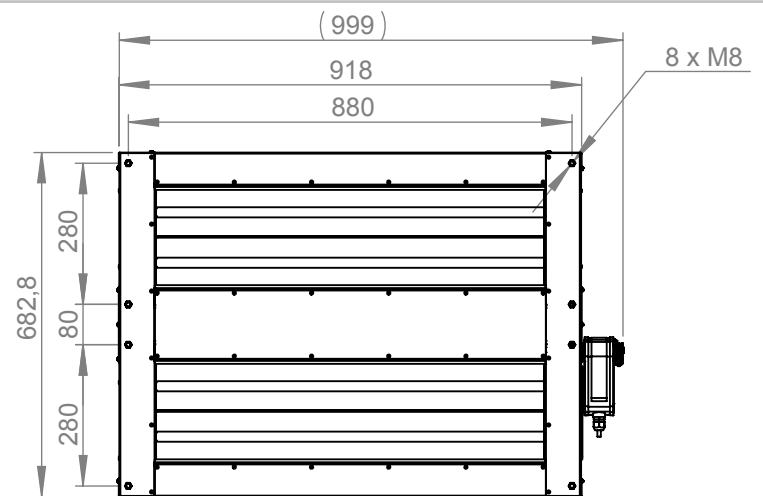


Außenluft / Fresh Air


Fortluft / Exhaust Air

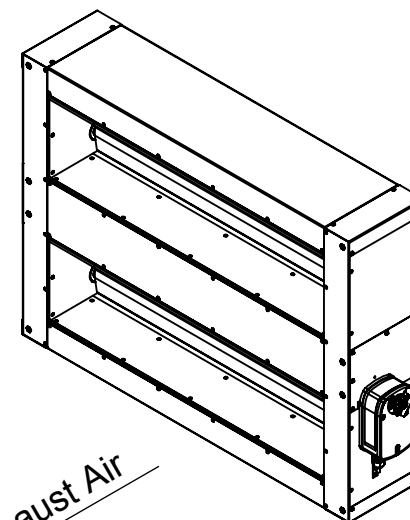

Duct connection	850 x 250
Flange	P 30

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg



Protection Mark
according to ISO 16016

Created a.ganea
Drawn a.ganea
Released a.ganea
Disabled

1:15 A4 mm

General tolerances
DIN ISO 2768-c

27.03.2018
27.03.2018
04.06.2024

MAKR2800V01+

145539 00